



Prevent • Promote • Protect

Environmental Health Division

1675 W. Garden of the Gods Rd., Suite 2044
Colorado Springs, CO 80907
(719) 578-3199 phone
(719) 575-8664 fax
www.elpasocountyhealth.org

ON-SITE WASTEWATER TREATMENT SYSTEM INSPECTION FORM

ON-SITE ID: ON0048850

P

APN # 4124001045

DATE: 2/13/2017

APPROVED YES ☒ NO ☐ Environmental Health Specialist: Neil Mayes

Address: 17335 Lovaca Dr, Peyton Co 80831 Owner: Kirlyn Fouts & Eric Whitney

Residence: ☒ #Bedrooms: 4 Commercial: ☐ System Installer: Property Owner

SEPTIC TANK: Construction Material Concrete Capacity Gallon 1250

SOIL TREATMENT AREA:

Trench: Depth (Range): Width: Total Length: Sq. Ft.:

Bed: Depth (Range): 12" - 30" Width: 40' Total Length: 100' Sq. Ft.: 4000 Low Pressure Drip

Depth of Rock: Under PVC: Type of cover on Rock:

SEEPAGE PITS: # of Pits: Working Depth #1: #2: Size (L x W) #1 #2 Total Sq. Ft.

CHAMBER SYSTEMS:

Type of Chamber: #Chambers: Sq. Ft./Chamber: Bed: ☐ Trench: ☐ Depth (Range):

Sq. Ft. Required (10-1): Sq. Ft. Required (10-2): Sq. Ft. Required (10-3): Sq. Ft. Required for Diverter Valve: (10-2)/(2)


Sq. Ft. Installed:

Engineer Design: Y ☒ N ☐ Engineering Firm: Entech Engineering, Inc Approval Letter Provided: Y ☒ N ☐

Well installed at time of OWTS inspection: Y ☒ N ☐ Public Water: Y ☐ N ☐

**Approval will be revoked if in the future the well is found to be within 50 feet of the septic tank and/or 100 feet of the soil treatment area.*

Notes:

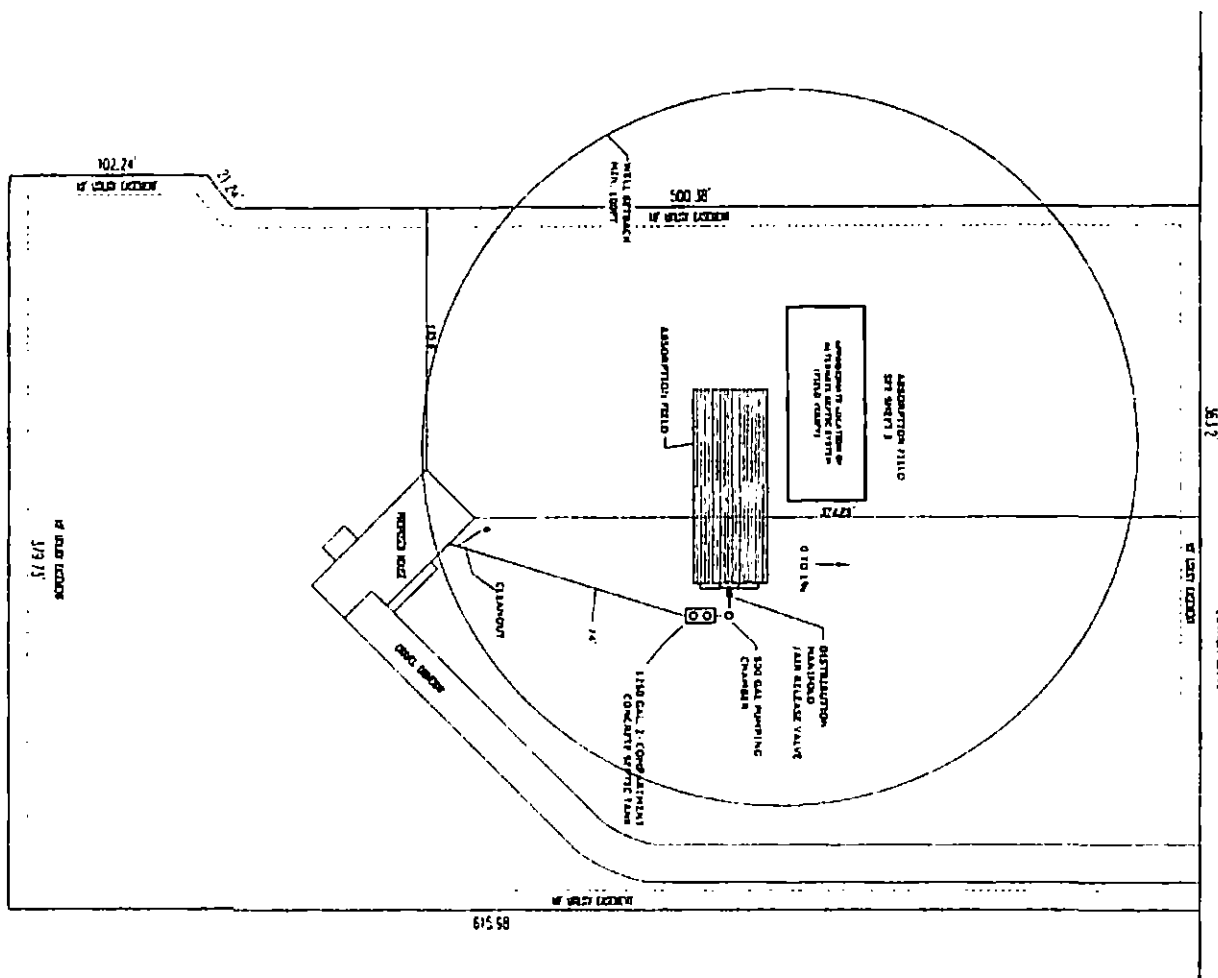

DATE OF BIRTH
PLACE OF BIRTH
EDUCATION
RELIGION
SEX
RACE
HEIGHT
WEIGHT
HAIR COLOR
EYES
SKIN
TATTOOS
SCARS
OTHER

ON-SITE WASTEWATER SYSTEM AS-BUILT
17335 LOVACA DRIVE
EL PASO COUNTY , COLORADO
FOR: WEBBCRAFT CONSTRUCTION



ENTECH
ENGINEERING, INC.
265 CLIFTON DRIVE
COLORADO SPRINGS, CO 80907 (719) 531-3779

REVISED	ET
3/2/16	IT

Attn: KIRLYN FOUTS & ERIC WHITNEY
17335 LOVACA DR
PEYTON, CO 80831

Notify Environmental Health of any change of ownership, type of business activity, business name, or billing address by calling (719) 578-3199. Failure to notify Environmental Health may result in late penalties, Permit/License denial or revocation, and business closure. PERMITS/LICENSES TO OPERATE AND ANNUAL FEE PAYMENTS ARE NOT TRANSFERABLE. Permits become void on change of ownership. New owners must apply and pay for a new Permit(s)/License(s) prior to beginning operation.



**EL PASO COUNTY PUBLIC HEALTH
ENVIRONMENTAL HEALTH DIVISION**
1675 W. GARDEN OF THE GODS ROAD, SUITE 2044
COLORADO SPRINGS, CO 80907
PHONE: (719) 578-3199 FAX: (719) 578-3188
www.elpasocountyhealth.org

NEW SYSTEM PERMIT - OWTS

Valid From 4/26/2016 To 4/26/2017

PERMITEE :

KIRLYN FOUTS & ERIC WHITNEY
17335 LOVACA DR
PEYTON, CO 80831

Onsite ID: ON0048850

Tax Schedule # : 4124001045

Permit Issue Date: 04/26/2016

Dwelling Type: RESIDENTIAL

OWNER NAME :

KIRLYN FOUTS & ERIC WHITNEY

of Bedrooms (if Res): 4

Proposed Use (if Comm):

Designed Gallons/Day:

Water Source: PRIVATE WELL

System Installation Requirements:

- Install according to Entech Engineering, Inc, job number 160328, dated 3/2/2016.
- NDDS System to be installed. If changes are made to the design, the health department must be contacted for approval.
- In order to install the engineered system, the installer must be Tier II Certified through El Paso County Public Health.
- An as-built drawing and certification letter are required prior to final approval.

The OWTS must be installed per the stamped and approved Design Document dated 04/26/2016.

This permit is issued in accordance with 25-10-106 Colorado Revised Statutes. The PERMIT EXPIRES upon completion/installation of the Onsite Wastewater Treatment System, or at the end of twelve (12) months from date of issue, whichever occurs first. If both a Building Permit and an Onsite Wastewater Treatment System Permit are issued for the same property and construction has not commenced prior to the expiration date of the Building Permit, the Onsite Wastewater Permit shall expire at the same time as the Building Permit. This permit is revocable if all stated requirements are not met. The Onsite Wastewater Treatment System must be installed by an El Paso County Licensed System Contractor, or the property owner.

The Health Officer shall assume no responsibility in case of failure or inadequacy of an Onsite Wastewater Treatment System, beyond consulting in good faith with the property owner or representative. Access to the property shall be authorized at reasonable time for the purpose of making such inspections as are necessary to determine compliance with the requirements of this law (permit)

**Inspection request line: Call (719) 575-8699 before 8:30 a.m. of the day that the inspection is requested
Weekends & Holidays excluded.**

Authorized By: Environmental Health Specialist



Environmental Health Division

1675 W. Garden of the Gods Rd., Suite 2044
Colorado Springs, CO 80907
(719) 578-3199 phone
(719) 578-3188 fax
www.elpasocountyhealth.org

Prevent • Promote • Protect

20004647/20004004

Ch # 8445

APPLICATION FOR AN ON-SITE WASTEWATER TREATMENT SYSTEM PERMIT

☒ NEW PERMIT ☐ MAJOR REPAIR PERMIT ☐ MINOR REPAIR PERMIT

Owner KIRLYN FORTS & ERIC WHITNEY Daytime Phone 719-332-3222

System Installer OWNER ABOVE. Daytime Phone _____

Property Address 17335 LOUAGA DRIVE City and Zip PEYTON 80831

Legal Description LOT 1A REATA SUB NO 2 A

Owners Mailing Address 5780 WEST CONOUR ROAD PEYTON, CO 80831

Email Address K6PHOTO6@AOL.COM Fax # 719-495-2995

Tax Schedule # 4124001045 Lot Size 5.19 ACRES

Site Located Inside City Limits ☐ Yes ☒ No Primary Contact ☒ Owner ☐ Contractor

Proposed Use: ☒ Single Family ☐ Multi-Family ☐ Commercial

Water Supply: ☒ Well ☐ Cistern ☐ Municipal Number of Bedrooms 4

☐ Pick up: ☐ Fax: ☒ Email: K6PHOTO6@AOL.COM

CURRENT FEES AS APPROVED BY THE EL PASO COUNTY BOARD OF HEALTH

New Permit: \$685.00 (EPOPH Charge) + \$147.00 (EPC Planning Dept. Surcharge) + \$23.00 (CDPHE Surcharge) = \$855.00

Major Repair Permit: \$525.00 (EPOPH Charge) + \$23.00 (CDPHE Surcharge) = \$548.00

Minor Repair Permit: \$240.00 (EPOPH Charge) + \$23.00 (CDPHE Surcharge) = \$263.00

- All Payments are due at the time of application submittal; by cash, check or major credit card (Visa / MC)
- This permit will expire one year from the date of issuance.

I certify that the information provided on this application is in compliance with Section 8.3, Chapter 8 of the Onsite Wastewater System (OWS) Regulations of the El Paso County Board of Health. I also authorize the assigned representative of El Paso County Public Health to enter onto this property in order to obtain information necessary for the issuance of a permit.

Applicants Signature: Kirlyn M Forts Date: 4-21-16

Site Insp. Date: 4/26/16 Perc. Rate: 0.3 Permit # 070048850

E.H.S. Review Notes: - NOOS

- Engineered

Date to: E.P.C. Development Services ☒ Flood Plain and Enumerations ☒

Permit Requirements: _____

Min. Septic Tank Capacity

Min. Absorption Area

E.H. Specialist CG Date 4/26/16 ☒ Approved ☐ Denied

Reviewed 2016 approved fee (12/30/2015)

Calder

- 1) A report is required per Section 8.5 A-E, "Site and Soil Evaluation", or Section 8.5 A-F if the OWTS requires design by a Colorado Registered Professional Engineer. If your permit application submittal is incomplete, the application will not be accepted.
- 2) Property address or lot number must be posted and clearly visible from the road. The percolation test holes and/ or soil profile test pit must be clearly marked or an additional charge for a return trip to the site may be assessed.
- 3) The proposed soil treatment area must be protected from compaction and disturbance by staking, fencing, posting or other effective method.
- 4) In the Box below, please provide complete and accurate directions to the property from a main highway.

NORTH OUT OF PEYTON FROM HWY 24 ON
BRADSHAW ROAD APP 3MI TO CLEESE CT
TURN LEFT (WEST) APP 1/2 MI TO LOVACA DR TURN
RIGHT 17335 LOVACA DR IS ON THE LEFT
GREEN GATE.