

EL PASO COUNTY DEPARTMENT OF HEALTH AND ENVIRONMENT  
INDIVIDUAL SEWAGE DISPOSAL SYSTEM INSPECTION FORM

Permit # 12189  
Date 9-8-98

APPROVED: YES ☒ NO ☒ # 4325004045

ENVIRONMENTALIST Lori Doane

Address 4135 Feather Ridge Drive Owner Rick & Kathi Bergeron

Legal Description Lot 163, Blue Sage Subd. Fil NO2

Residence ☒ # of bedrooms 3; Commercial ☐; System Installer Murray Constr.

SEPTIC TANK:

Commercial ☒; Noncommercial ☐ L ☐ W ☐ WD  
Construction Material Recast Concrete, capacity 1250 gallons.

DISPOSAL FIELD:

Rock Systems:

Trench: depth ☐, width ☐, total length ☐, sq. feet ☐

Bed: depth ☐, length ☐, width ☐, sq. feet ☐

Rock type ☐, depth ☐, under PVC ☐, over PVC ☐

Seepage Pits: # of pits ☐, total # of rings ☐, working depth(s) ☐

size of pit(s) L X W ☐, lining material ☐, total sq. feet ☐

Rockless Systems:

Chamber: Type Infiltrator, number of chambers 43, bed ☐, trench ☒

sq. ft./section 155, reduction allowed 40%, sq. ft. required 1086

total sq. ft. installed 1111, depth of installation 30"-42"

Engineer Design Y or N Designing Engineer


Approval letter provided? Y or N

Well 50 feet from tank Y or N 100 feet from leach field Y or N

Well installed at time of septic system inspection Y or N Public Water ☒

\*Approval will be revoked if in the future the well is found to be within 50 feet of the septic tank and/or 100 feet of the disposal field.

NOTES:

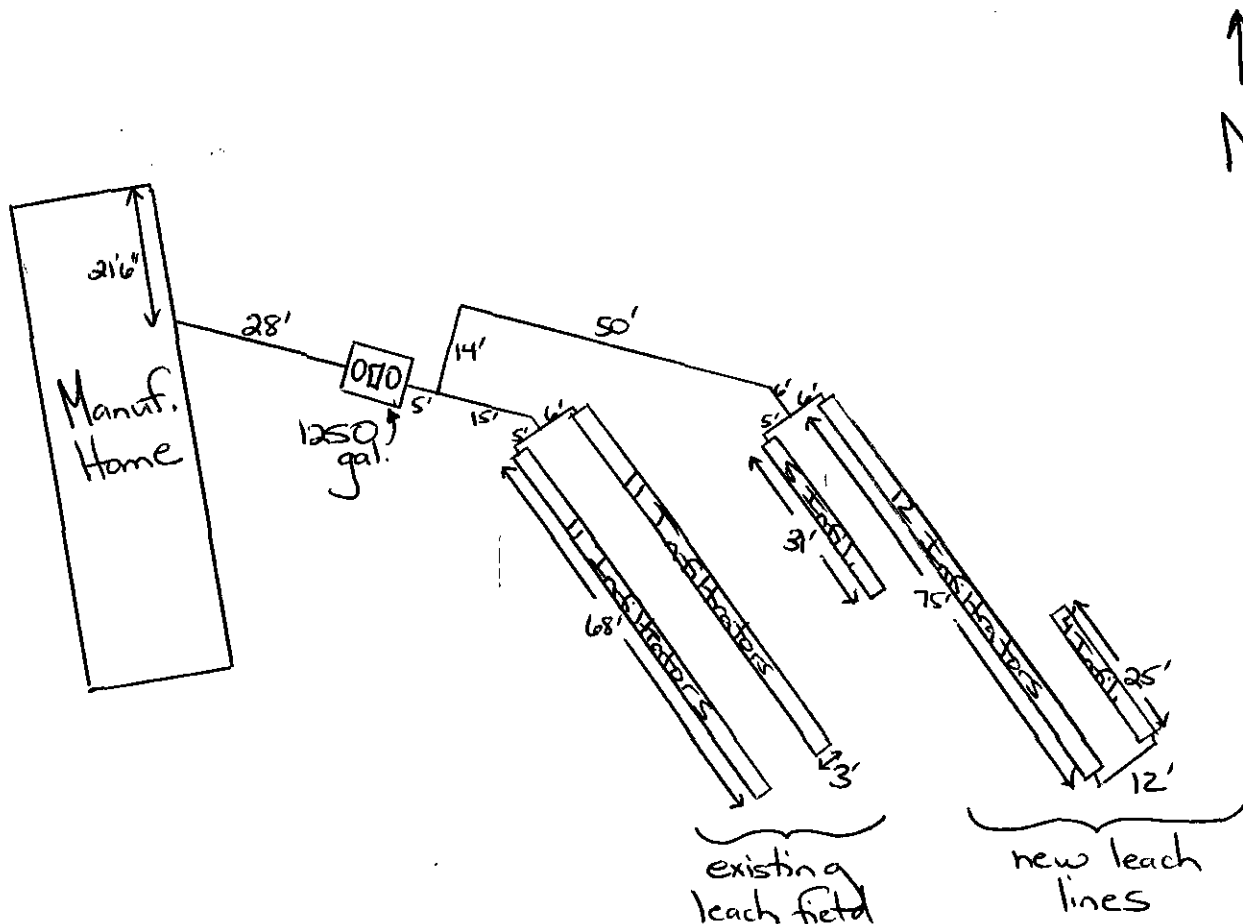

Acres 2.5 **EL PASO COUNTY • DEPARTMENT OF HEALTH AND ENVIRONMENT**  
301 South Union Blvd. • Colorado Springs, Colorado • 578-3125

Water Supply CENTRAL

Permit 12189

**PERMIT**

**TO CONSTRUCT, ALTER, REPAIR OR MODIFY ANY INDIVIDUAL SEWAGE DISPOSAL SYSTEM**

Receipt No. NONE

Issued to RICK & KATHI BERGERON

Date 4-8-98

Address of Property 4135 FEATHER RIDGE DRIVE, LOT 163, BLUE SAGE SUBD.

Phone 683-5291

(Permit valid at this address only)

Sewage-Disposal System work to be performed by D & B TRENCHING

Phone 683-2400

This Permit is issued in accordance with 25-10-106 Colorado Revised Statutes 1973, as amended. PERMIT EXPIRES upon completion of installation of sewage-disposal system or at the end of twelve (12) months from date of issue—whichever occurs first—(unless work is in progress). This permit is revokable if all stated requirements are not met.

**-THIS PERMIT DOES NOT DENOTE APPROVAL OF ZONING AND ACREAGE REQUIREMENTS-**

**NO FEE**

PERMIT FEE (NOT REFUNDABLE)

4-8-98

Steven J. Englander, MD  
DIRECTOR, DEPARTMENT OF HEALTH AND ENVIRONMENT

Shirley L. Lee, Doane 578-313  
ENVIRONMENTALIST

DATE OF EXPIRATION

**NOTE: LEAVE ENTIRE SEWAGE-DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION. 48 HOUR ADVANCE NOTICE REQUIRED.**

SEPTIC TANK:	TRENCH SYSTEM:	BED SYSTEM:	SEEPAGE PIT SYSTEM:
EXISTING	total square feet <u>1086</u>		total square feet
gallons	ft. of trench inches wide	total square feet	rings or diam.x w/d
	ft. of trench inches wide		

**NOTES:** ADDITION TO LEACH FIELD AT OWNER'S REQUEST. MINIMUM NUMBER OF ADDITIONAL CHAMBERS 21 IN TRENCHES OR 24 IN A BED. IF DIVERTER VALVE IS USED BETWEEN OLD AND NEW FIELDS, NEW FIELD MUST HAVE THE TOTAL - 1086 SQ. FT. (43 CHAMBERS IN TRENCHES OR 46 CHAMBERS IN A BED).

The Health Office shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable time for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

**RECEIVED**  
**JAN - 2**  
**APPLICATION FOR A NEW, REMODEL, REPAIR, OR ADDITION**  
**TO AN INDIVIDUAL SEWAGE DISPOSAL SYSTEM**

Owner CHRIS & KATHI BERGERON Phone 683-5291  
Address of Property 4135 FEATHER RIDGE DR. Lot Size 2 1/2 Water Supply CENTRAL  
Tax Sch # 43250-04-045 Septic Contractor & Phone # D & B TRENCHING 683-2400  
Legal Description BLUESAGE SUBDIVISION LOT 163  
Type of Building MOBILE RESIDENTIAL Owner's Mailing Address 4135 FEATHER RIDGE DR. PEYTON CO. 80831

MAXIMUM POTENTIAL BEDROOMS 3

Basement Y ☒ N Percolation Test Attached Y ☒ N Garbage Disposal Y ☒ N Clothes Washer ☒ N

I have supplied a plot plan as described on the back of this form. I acknowledge the completeness of the application is conditional upon such further mandatory and additional tests and reports as may be required by the Department to be made and furnished by a applicant for purposes of evaluating the application, and issuance of the permit is subject to such terms and conditions as deemed necessary to ensure compliance with rules and regulations adopted pursuant to C.R.S. 10-25-101 et. seq. I hereby certify all represented to be true and correct to the best of my knowledge and belief, and are designed to be relied on by the El Paso County Department of Health and Environment in evaluating the same for purposes of issuing the permit applied for herein. I further understand any falsification or misrepresentation may result in the denial of the application or revocation of any permit granted based upon said application and in legal action for perjury as provided by law.

OWNER'S SIGNATURE [Signature] Date 1-6-98

DEPARTMENT OF HEALTH USE ONLY		
Absorption Area <u>1086</u>	Tank Capacity <u>Existing</u>	Date of Site Inspection <u>1-6-98</u>
REMARKS: <u>Addition to leach field at owner's request. Minimum number of additional chambers = 21 in trenches or 24 in a bed. If diverter valve is used between old &amp; new leach fields, new field must have the total 1086 sq. ft (43 chambers in trenches or 46 chambers in a bed).</u>		
EHS INSPECTOR <u>[Signature]</u>	Date <u>1-6-98</u>	<input checked="" type="radio"/> APPROVED <input type="radio"/> DENIED
PERMIT # <u>12189</u>	FEE <input checked="" type="radio"/> NO FEE	DATE TO EPC PLANNING DEPT <u>N/A</u>

Mail original to owner 4/8/98  
copy Brian Skunk 4/8/98

We require the ORIGINAL of your percolation (**PERC**) **TEST**.

The following information must be on your **PLOT PLAN**.

Property lines

Proposed septic system site

Well(s)

Building(s)

Water line

Subsoil drain(s)

Property dimensions

Designated alternate septic system site

Adjacent property well(s)

Proposed building(s)

Cistern

If any of these are within 100 feet of your proposed septic system  
include on your plot plan

Spring(s)

Pond(s)

Dry Gulch(s)

Lake(s)

Stream(s)

Natural drainage course(s)

PROPERTY AND PERC HOLES MUST BE CLEARLY MARKED OR POSTED

GIVE COMPLETE DIRECTIONS TO THE PROPERTY FROM A MAIN HIGHWAY

