

EL PASO COUNTY DEPARTMENT OF HEALTH AND ENVIRONMENT  
INDIVIDUAL SEWAGE DISPOSAL SYSTEM INSPECTION FORM

Permit # ON0004065  
Date 5-31-2002

APPROVED: YES ☒ NO ☐ 5133004011 ENVIRONMENTALIST Brad Wallace

Address 7980 Wildridge Road Owner Dennis Baran

Legal Description LOT 5, B1K 3, Wildwood Ranch Estates  
Residence ☒, # of bedrooms 3; Commercial ☐; System Installer (Numerous)  
**SEPTIC TANK:** Existing + Addition 5-2002 Underground Solution  
Commercial ☒; Noncommercial ☐ L        W        WD         
Construction Material Pre-cast concrete, capacity (1000 + 1000) gallons.


**DISPOSAL FIELD:**

**Rock Systems:**  
Trench: depth       , width some 3', total length 355', sq. feet 905 FT<sup>2</sup>  
Bed: depth       , length       , width       , sq. feet         
Rock type       , depth       , under PVC       , over PVC         
Seepage Pits: # of pits       , total # of rings       , working depth(s)         
size of pit(s) L X W       , lining material       , total sq. feet       

**Rockless Systems:**

Chamber: Type       , number of chambers       , bed       , trench         
sq. ft./section       , reduction allowed       %, sq. ft. required         
total sq. ft. installed       , depth of installation         
Engineer Design Y or (N), Designing Engineer         
Approval letter provided? Y or N         
Well 50 feet from tank (Y) or N        100 feet from leach field (Y) or N         
Well installed at time of septic system inspection (Y) or N        Public Water         
\*Approval will be revoked if in the future the well is found to be within 50 feet of the septic tank and/or 100 feet of the disposal field.

**NOTES:** Many additions over the years to this system. I obtained distances from old drawings and owners information.

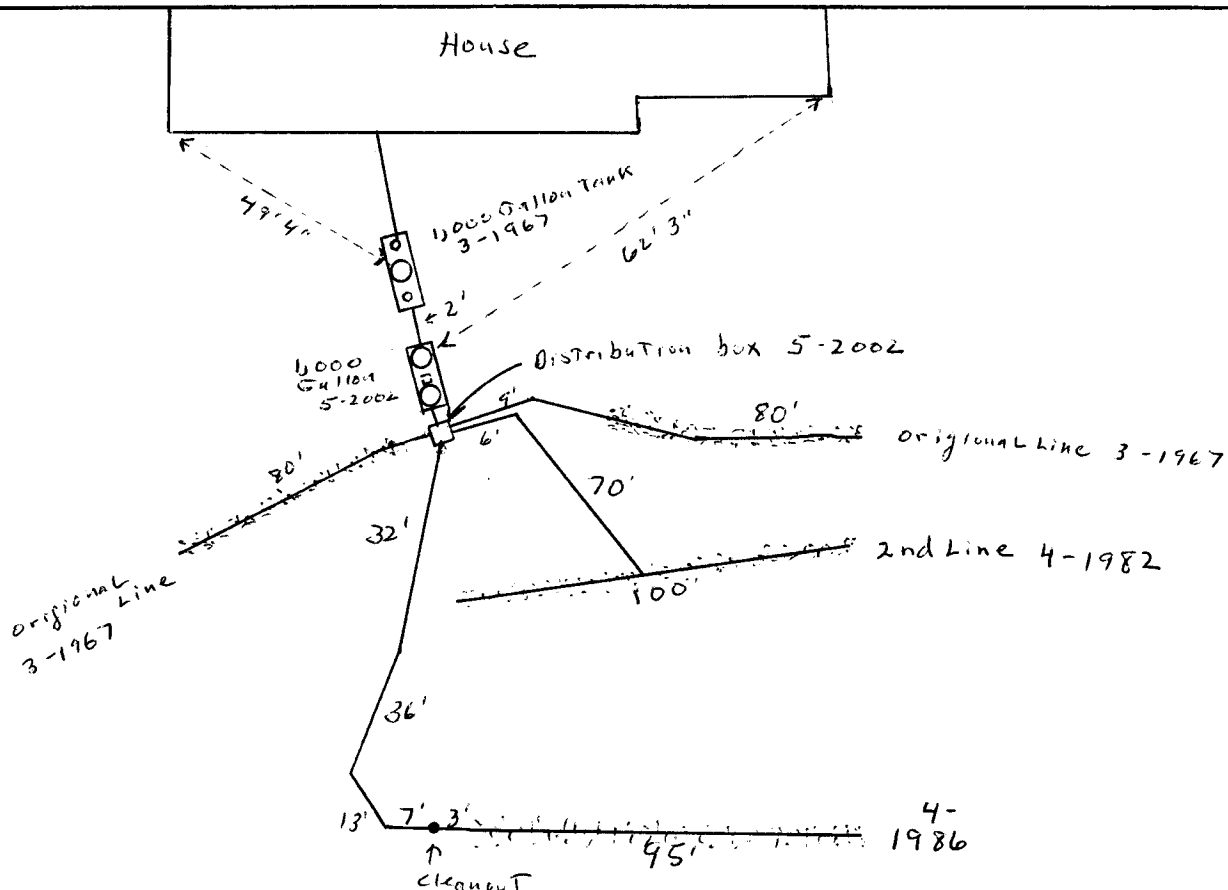

## INDIVIDUAL SEWAGE DISPOSAL SYSTEM PERMIT

OWNER NAME: DENNIS BARAN  
ADDRESS: 7980 WILDRIDGE RD  
CITY, STATE, ZIP: COLORADO SPRINGS CO 80908  
INSTALLED BY:

PERMIT NUMBER: ON0004065  
DATE PERMITTED: 05/13/2002  
PHONE NUMBER: 7194954726

This permit is issued in accordance with 25-10-107 Colorado Revised Statutes. PERMIT EXPIRES upon completion-installation of sewage-disposal system or at the end of twelve (12) months from date of issue- whichever occurs first-(unless work is in progress). If both a building and an ISDS permit are issued for the same property and construction has not commenced prior to the expiration date of the building permit, the ISDS permit shall expire at the same time as the building permit. This permit is revokable if all stated requirements are not met.

Sewage disposal system to be installed by an El Paso County Licensed System Contractor or the property owner.

**THIS PERMIT DOES NOT DENOTE APPROVAL OF ZONING AND ACREAGE REQUIREMENTS.**

*John Dower*

DIRECTOR, EL PASO COUNTY DEPARTMENT OF HEALTH AND ENVIRONMENT

PERMIT EXPIRATION DATE :  
Expires twelve months from date of issue

*Janet Christensen* - 578-3141  
ENVIRONMENTALIST / PHONE NUMBER\*

\* NOTE: FOR INSPECTIONS CALL 575-8699 BEFORE 8:30 A.M. OF THE DAY TO BE INSPECTED.  
(WEEKENDS & HOLIDAYS EXCLUDED)

LEAVE THE ENTIRE SEWAGE DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION.

WATER SOURCE: WELL

MINIMUM SEPTIC TANK SIZE : 1,000 GALLONS MINIMUM ABSORPTION AREA REQUIRED 255 SQ FT

PLANNING DEPARTMENT

N/A

ENUMERATION

N/A

FLOOD PLAIN

N/A

WASTEWATER

N/A

### COMMENTS:

OWNER PROPOSES TO REPAIR EXISTING LEACH FIELD BY ADDITION OF ANOTHER SEPTIC TANK IN SERIES WITH EXISTING 1000 GALLON SEPTIC TANK AND HAVING EXISTING DISTRIBUTION BOX REPAIRED, LEACH LINES CLEANED AND CONNECTIONS MADE EVENLY DISTRIBUTE EFFLUENT. THE 320 FEET OF 1967 LEACH LINE IS NOT OPERATIONAL-LEAVING 585 FEET OF 1982 AND 1986 LEACH LINE REMAINING. PER ORIGINAL 1967 PERMIT, A MINIMUM OF 255 FEET OF LEACH FIELD IS REQUIRED. IF THIS ABSORPTION SYSTEM IS ABANDONED, A NEW ALTERNATE SITE AND PERCOLATION TEST AND PERMIT WILL BE REQUIRED.

The Health Office shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable time for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

### FOR ADMINISTRATIVE USE ONLY

Permit Ready: 5/16/02 Called Mailed Mailed

Final Inspection Requested: BY: Underground Salubria

Date Called In: 5/30/02 3:53 p

Phone # 687-0934

Septic Site will be ready: \_\_\_\_\_