

EL PASO COUNTY HEALTH DEPARTMENT
COLORADO SPRINGS, COLORADO

SEWAGE DISPOSAL INSPECTION FORM

Permit No. 2001
DATE 4/27/83 P

APPROVAL:
YES ☒ NO ☐

532400002

ENVIRONMENTALIST

LOCATION (street number) 11725 Garrett Rd. OCCUPANT Otis Linkbride

LEGAL DESCRIPTION S 24 T 13S R 65 W

TYPE OF CONSTRUCTION Mobile NO. OF BEDROOMS 3

SYSTEM INSTALLED BY Mikeita Epc.

COMMERCIAL MFG. El Paso SIZE 1250g


TYPE OF MATERIAL Cement NO. COMPARTMENTS 2

WIDTH 60" LENGTH 120" DEPTH (total) 68" LIQ. CAP. 1250g

DISPOSAL FIELD: BED OR TRENCH DEPTH 30" WIDTH 36" LENGTH 240' SQ. FT. 720

DISTANCE BETWEEN LINES 10' ROCK 1 1/2" DEPTH 12" UNDER 6" OVER 2"

LEACHING PITS (NO.) Lining MATERIAL CAPACITY SQ. FT.

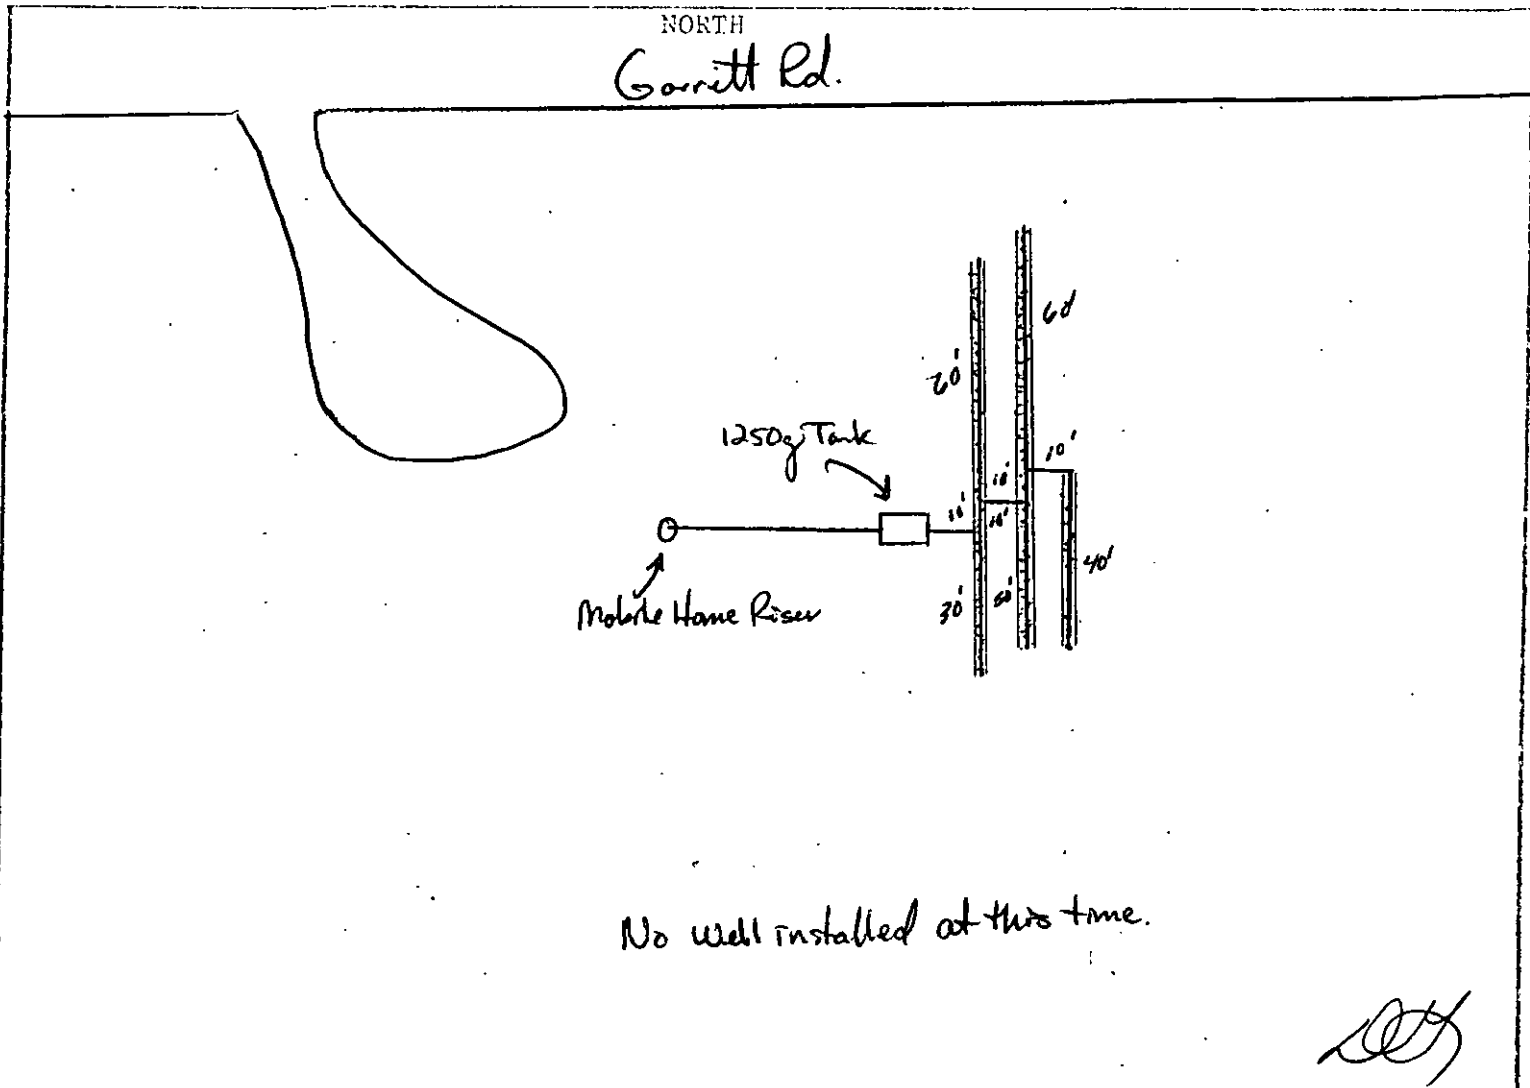

Acres 5**EL PASO COUNTY • COUNTY HEALTH DEPARTMENT**Permit No. 2001Water Supply Well

501 North Foote Avenue • Colorado Springs, Colorado • 636-0125

Receipt No. 3031**PERMIT****TO CONSTRUCT, ALTER, REPAIR or MODIFY ANY INDIVIDUAL SEWAGE DISPOSAL SYSTEM**Issued To Otis E & Kathryn KirkbrideDate 4/18/83Address of Property 11775 Garrett Road, Falcon, CO.Phone 635-4557

(Permit valid at this address only)

Sewage-Disposal System work to be performed by Joe Muktas Phone _____

This Permit is issued in accordance with 25-10-106 Colorado Revised Statutes 1973, as amended. PERMIT EXPIRES upon completion-installation of sewage-disposal system or at the end of six (6) months from date of issue — whichever occurs first — (unless work is in progress).

— THIS PERMIT DOES NOT DENOTE APPROVAL OF ZONING AND ACREAGE REQUIREMENTS —

\$140.00

PERMIT FEE

Dr. John B. Muth,

DIRECTOR, CITY-COUNTY HEALTH DEPARTMENT

October 18, 1983

DATE OF EXPIRATION

ENVIRONMENTALIST

NOTE: LEAVE ENTIRE SEWAGE-DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION. 48 HOUR ADVANCE NOTICE REQUIRED.

SEPTIC TANK SIZE <u>1250</u>	GALLONS	TOTAL ABSORPTION AREA <u>630</u>	SQ. FT.
TRENCH SYSTEM	BED SYSTEM	SEEPAGE PIT SYSTEM	
<u>210</u> ft. of trench <u>36</u> inches wide	_____ ft. x _____ ft.	_____ rings or _____ diam. x _____ w/d	

NOTES:

OR 315 ft. of trench 24 inches wide.

The Health Office shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable times for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

Date April 6, 1983

EL PASO COUNTY HEALTH DEPARTMENT
501 NORTH FOOTE AVENUE
COLORADO SPRINGS, COLORADO
636-0125

TAX SCHEDULE # 53240-00-
471-5562 002

Application for permit to construct, Remodel, or Install a Sewage Disposal System.

Name of Owner OTIS E. & KATHRYN A. KIRKBRIDE Phone 635-4557

Address of Property 11715 Darrett Rd. Falcone & Mundian

Legal Description of Property SECTION 24 / TWP 13 / S RANGE 65 / EL PASO Co

Owner's Address (if different) 32 S. CLAREMONT, Colo. Spgs Phone 635-4557

Systems Contractor T & C Excavating Address _____

Type of Construction Mobile Home source and type of water supply WELL

Size of Lot 5 A

The construction of the Sewage Disposal System will comply with all applicable Laws, Ordinances, Standards or Resolutions.

HEALTH DEPARTMENT USE ONLY

Permit Number _____

Receipt Number _____

Number of Bedrooms 3 Tank Capacity 1250 gallons Absorption area 630 Sq. Ft.

Remarks Approved pending Conduse approval
210 linear feet of 36-inch ^{wider} trench or
315 linear feet of 24-inch ^{wider} trench

APPLICATION IS ☒ APPROVED ☐ DENIED

ENVIRONMENTALIST Off Kania

DATE 4/15 1983

PLOT PLAN WILL INCLUDE THE FOLLOWING

Plot plan may be drawn on the back of this sheet or on a separate sheet.


1. Streams, Lakes, Ponds, Irrigation Ditches and other Water Courses
2. North Direction
3. Location of Property Line
4. Buildings
5. Wells
6. Location of Proposed Septic System
7. Location of percolation test
8. Geographical features
9. Other Information as required

Copy

Garrett Rd

WELL
↓
○

SEPTIC
SYSTEM



↑
HOME



SEPTIC
SYSTEM

~~Garrett~~ Garrett

Corner of Garrett & Meridian intersection S.W.
next to corner lot. Said in the very back
of this lot are some old car. 2 brick home across
from this property -