

Tax # 5732005018

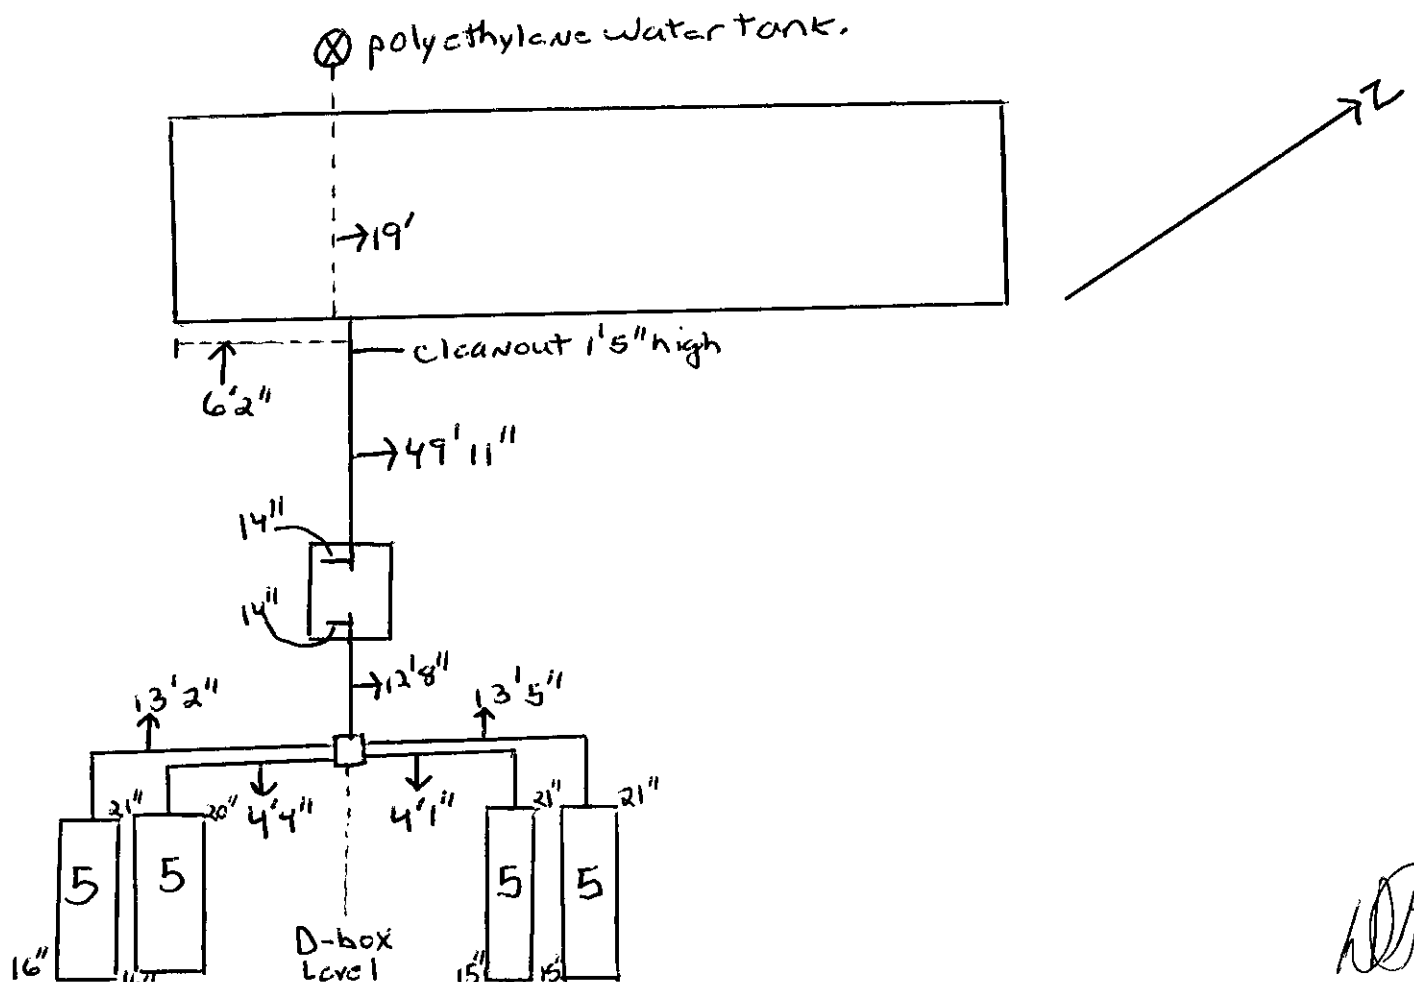
EL PASO COUNTY DEPARTMENT OF HEALTH AND ENVIRONMENT
INDIVIDUAL SEWAGE DISPOSAL SYSTEM INSPECTION FORMPermit # 2086
Date 31 August 2000APPROVED: YES X NO ENVIRONMENTALIST ParreiraAddress 21210 Armadillo Heights Owner RuddLegal Description Lot 75 Frontier VillageResidence X, # of bedrooms 1; Commercial ; System Installer OWNER**SEPTIC TANK:**Commercial X; Noncommercial , L , W , WD
Construction Material Concrete, capacity 1000 gallons.**DISPOSAL FIELD:****Rock Systems:**Trench: depth , width , total length , sq. feet Bed: depth , length , width , sq. feet Rock type , depth , under PVC , over PVC Seepage Pits: # of pits , total # of rings , working depth(s)
size of pit(s) L X W , lining material , total sq. feet **Rockless Systems:**Chamber: Type Infiltrators, number of chambers 20, bed , trench X
sq. ft./section 15.5, reduction allowed 40 %, sq. ft. required 455total sq. ft. installed 517.5 sq. ft., depth of installation 15"-21"Engineer Design Y or (N), Designing Engineer

Approval letter provided? Y or N

Well 50 feet from tank Y or N 100 feet from leach field Y or N

Well installed at time of septic system inspection Y or (N) Public Water NO

*Approval will be revoked if in the future the well is found to be within 50 feet of the septic tank and/or 100 feet of the disposal field.

NOTES: SDR 35 Schedule 40 white polyethylene water tank used for water.

EL PASO COUNTY
DEPARTMENT OF HEALTH AND ENVIRONMENT
301 S Union Blvd, Colorado Springs, Colorado 719-578-3126

INDIVIDUAL SEWAGE DISPOSAL SYSTEM PERMIT

WATER SOURCE: CISTERN

PERMIT NUMBER: ON0002086

OWNER NAME: KENNETH E RUDD

DATE PERMITTED: 6/30/00

ADDRESS: 21210 ARMADILLO HGHTS

CITY, STATE, ZIP: PUEBLO

81008

PHONE NUMBER: 7192712197

INSTALLED BY:

This permit is issued in accordance with 25-10-107 Colorado Revised Statutes. PERMIT EXPIRES upon completion-installation of sewage-disposal system or at the end of twelve (12) months from date of issue- whichever occurs first-(unless work is in progress). If both a building and an ISDS permit are issued for the same property and construction has not commenced prior to the expiration date of the building permit, the ISDS permit shall expire at the same time as the building permit. This permit is revokable if all stated requirements are not met. Sewage disposal system to be installed by an El Paso County Licensed System Contractor or the property owner.

THIS PERMIT DOES NOT DENOTE APPROVAL OF ZONING AND ACREAGE REQUIREMENTS.

PERMIT FEE(NON REFUNDABLE):

New Permit----\$ 300.00

ISDS Repair -\$ 50.00

Voided/Altered permit --\$ 25.00

Jisha Dower
DIRECTOR, EL PASO COUNTY DEPARTMENT OF HEALTH AND ENVIRONMENT

PERMIT EXPIRATION DATE:

Expires twelve months from date of issue

for planning For Jim Goodwin / 578-3142
ENVIRONMENTALIST / PHONE NUMBER

NOTE: LEAVE THE ENTIRE SEWAGE DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION, 48 HOUR ADVANCE NOTICE REQUIRED.

MINIMUM SEPTIC TANK SIZE: 1,000 GALLONS

MINIMUM ABSORPTION AREA REQUIRED

455 SQ FT

PLANNING DEPARTMENT ☒

ENUMERATION ☒

FLOOD PLAIN ☒

WASTEWATER ☒

COMMENTS:

THE RESIDENCE MAY ONLY REMAIN OCCUPIED UNTIL 12/31/00 WITHOUT AN APPROVED SEPTIC SYSTEM OR OTHER APPROVED I.S.D.S DURING THIS PERIOD, ALL WASTEWATER SHALL BE DISPOSED OF IN AN APPROVED MANNER SUCH AS BY THE USE OF A CHEMICAL TOILET, OR BY TRANSPORTING THE WASTE TO A PERMITTED R.V. DUMP STATION. THE SYSTEM SHALL BE INSTALLED BY THE OWNER, OR I.S.D.S. CONTRACTOR, LICENSED IN EL PASO COUNTY. THE LEACH FIELD SHALL BE INSTALLED AT A DEPTH OF ABOUT 48" WITH NO PART OF THE LEACH FIELD DEEPER THAN 60". NOTE THAT THE SOIL TEST ENGINEER RECOMMENDS OVERSIZING THE LEACH FIELD DUE TO THE FINE-GRAINED NATURE OF THE SOIL.

The Health Office shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable time for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

Inspector

Record I.D. 2086

EL PASO COUNTY ENVIRONMENTAL HEALTH SERVICES

301 South Union Boulevard • Colorado Springs, CO • 80910-3123 • (719) 578-3126

APPLICATION FOR A ☒ NEW ☐ REMODEL ☐ REPAIR OR ☐ ADDITIONTO AN INDIVIDUAL SEWAGE DISPOSAL SYSTEM ☐ P.E. DESIGNOwner Kenneth E. Rudd (322-9264 leave message) Daytime Phone 271-2197 cellAddress of Property 21210 ARMADILLO HTS. City & Zip Pueblo-81008Legal Description LOT 75 FRONTIER VILLAGETax Schedule # 57320-05-018 Lot Size 6.1 ACRES Septic Contractor _____Inside City Limits ☐ No ☒ Yes-City _____ Water Supply ☐ Well or Spring ☒ Cistern ☐ PublicType of Building ☐ Frame ☐ Modular ☒ Mobile ☐ Commercial ☐ Manufactured ☐ Other _____Owner's MAILING Address Same City, State & Zip Pueblo, Co. 81008☒ MAIL PERMIT OR ☒ PICK UP PERMIT ☐ THERE IS AN ADDITIONAL RESIDENCE ON THIS PROPERTYMAXIMUM POTENTIAL BEDROOMS 1Percolation Test Attached ☒ Y ☐ NGarbage Disposal Y ☐ NBasement Y ☐ NClothes Washer ☒ Y ☐ N

I have supplied a plot plan as described on the back of this form. I acknowledge the completeness of the application is conditional upon such further mandatory and additional tests and reports as may be required by the Department to be made and furnished by an applicant for purposes of evaluating the application, and issuance of the permit is subject to such terms and conditions as deemed necessary to ensure compliance with rules and regulations adopted pursuant to C.R.S. 25-10-107 et. seq. I hereby certify all represented to be true and correct to the best of my knowledge and belief, and are designed to be relied on by the El Paso County Department of Health and Environment in evaluating the same for purposes of issuing the permit applied for herein. I further understand any falsification or misrepresentation may result in the denial of the application or revocation of any permit granted based upon said application and in legal action for perjury as provided by law.

OWNER'S SIGNATURE

Kenneth E. RuddDate 6/19/00

DEPARTMENT OF HEALTH USE ONLY

455
Minimum Absorption Area1000
Minimum Tank Capacity6/22/00
Date of Site Inspection

REMARKS The residence may only remain occupied ~~for a maximum~~ until 12/31/00 without an approved septic system, or other approved ISDS. During this period, all wastewater shall be disposed of in an approved manner, such as by the use of a chemical toilet, or by transporting the waste to a permitted RV dump station. ~~The system~~ The system shall be installed by the owner, or an ISDS contractor licensed in El Paso County. The leachfield shall be installed at a depth of ~~at~~ about 48" with no part of the leachfield deeper than 60". Note that the soil test engineer recommends oversizing the leachfield due to the fine-grained nature of the soil.

EHS INSPECTOR [Signature]DATE 6/22/00APPROVED ☒ DENIED ☐

FEE NO FEE

DATE TO PLANNING / WASTEWATER 6-21

- 1) We require a copy of your percolation (**PERC**) **TEST** with an original professional engineer's (P.E.) stamp and signature.
- 2) A **PLOT PLAN** must be drawn (not to scale) on a 8 ½ x 11 sheet of paper. The plot plan must include
 - 1) a north bearing
 - 2) property lines
 - 3) property dimensions
 - 4) all buildings (proposed or existing)
 - 5) proposed septic system site
 - 6) designated alternate septic system site
 - 7) driveway (proposed or existing and name of adjoining street)
- 3) Initial any of the following features that apply to your property and include them on your plot plan.

_____ Well(s)	_____ Adjacent property well(s)	_____ Subsoil drain
_____ Cistern	_____ Water line	
- 4) Initial any of the following that are within 100 feet of your proposed septic system and include on your plot plan.

_____ Spring(s)	_____ Lake(s)
_____ Pond(s)	_____ Stream(s)
_____ Dry Gulch(es)	_____ Natural drainage course(s)
- 5) **PROPERTY ADDRESS OR LOT NUMBER MUST BE POSTED AND CLEARLY VISIBLE FROM ROAD.**
PERC HOLES MUST BE CLEARLY MARKED.

6) GIVE COMPLETE DIRECTIONS TO THE PROPERTY FROM A MAIN HIGHWAY