

ON#

#6309012002

P

EL PASO COUNTY HEALTH DEPARTMENT
COLORADO SPRINGS, COLORADO

237

SEWAGE DISPOSAL INSPECTION FORM

Permit No. 337

APPROVAL:

YES ☒ NO

DATE

6/6/79

ENVIRONMENTALIST

Rock A. Fung

LOCATION (street number)

1973 Shrader Rd

OCCUPANT

LEGAL DESCRIPTION

Lot 1 Block 12 F.E. #3

TYPE OF CONSTRUCTION

Single Family

NO. OF BEDROOMS

4

SYSTEM INSTALLED BY

Ron's Ditching

COMMERCIAL MFG.

SIZE

1250

TYPE OF MATERIAL

Concrete

NO. COMPARTMENTS

2

WIDTH

67

LENGTH

109

DEPTH (total)

70

LIQ. CAP

1250

DISPOSAL FIELD: BED OR TRENCH DEPTH

WIDTH

LENGTH

SQ. FT

DISTANCE BETWEEN LINES 10' 14'

ROCK 1' RIVER ROCK

DEPTH

18"

UNDER

6"


OVER

2"

LEACHING PITS (NO.)

LINING MATERIAL

CAPACITY SQ. FT.

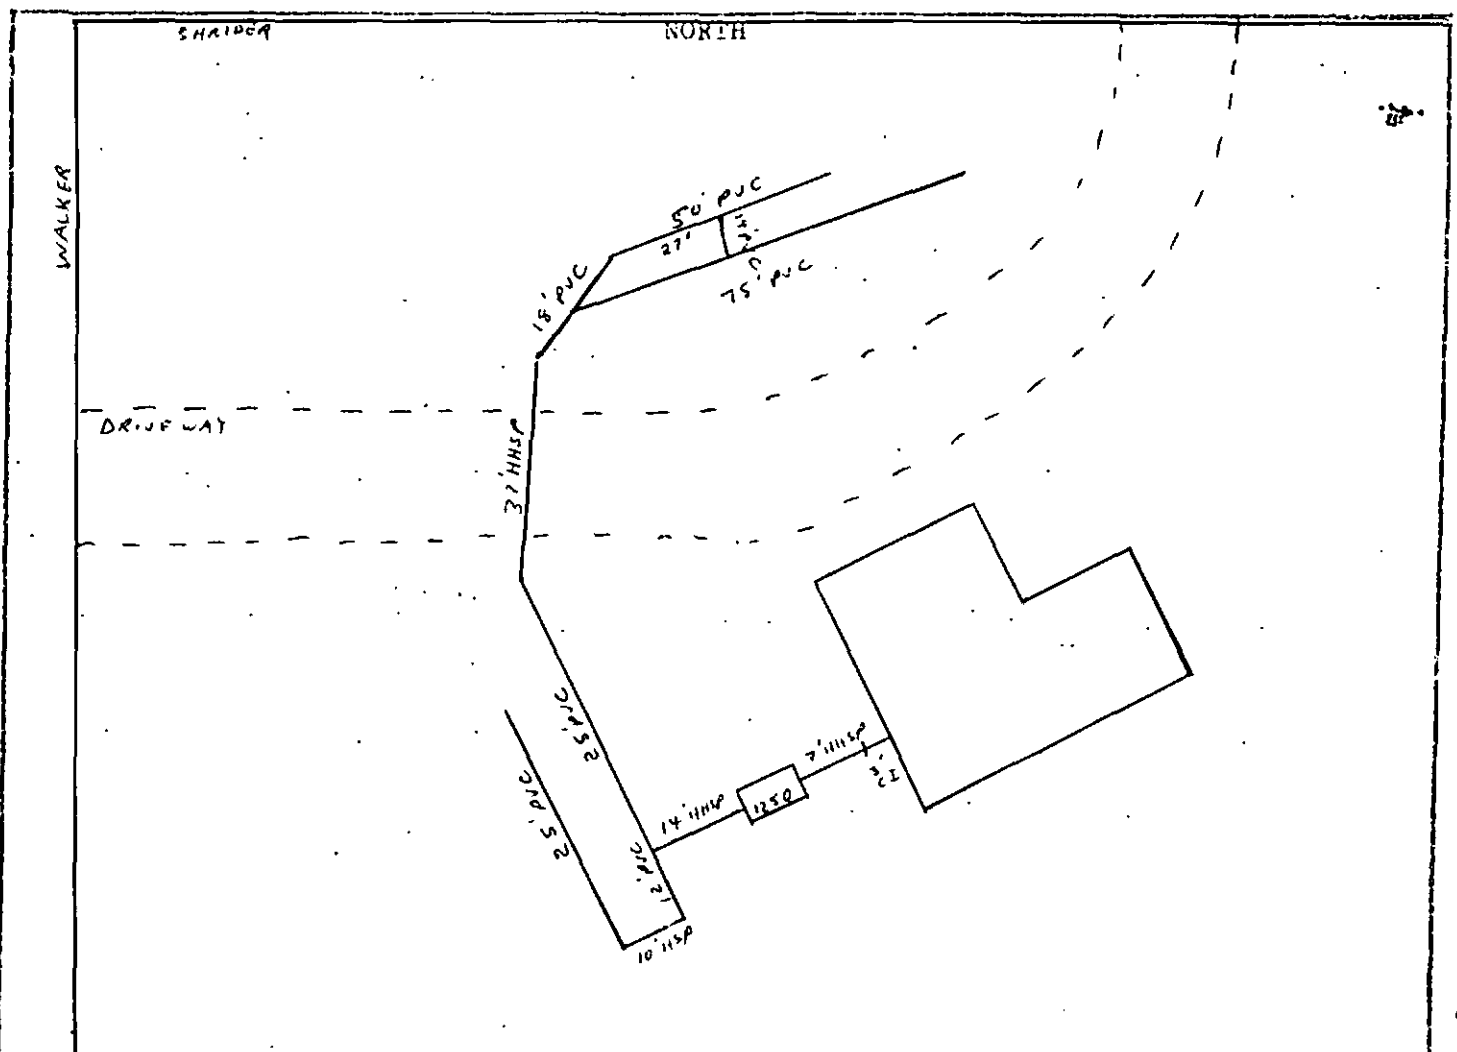

28

Acres 2.4

EL PASO COUNTY • COUNTY HEALTH DEPARTMENT
501 North Foote Avenue • Colorado Springs, Colorado • 475-8240

000337

Water Supply Woodman Water

PERMIT

Receipt No. 1683

TO CONSTRUCT, ALTER, REPAIR OR MODIFY AN INDIVIDUAL SEWAGE DISPOSAL SYSTEM

Issued To Wally Nesselhauf

Date May 24, 1979

Address of Property 1973 Shrider Road, Lot 1, Block 12 Falcon Estates, Colorado

(Permit valid at this address only)

IDENTIFIED AREA

Sewage—Disposal System work to be performed by Mountain Shadows Plumbing

Phone _____

This Permit is issued in accordance with 25-10-106 Colorado Revised Statutes 1973, as amended. PERMIT EXPIRES upon completion installation of sewage-disposal system or at the end of six (6) months from date of issue - whichever occurs first - (unless work is in progress).

- This Permit does not denote approval of zoning and acreage requirements. -

Charles H. Dowding, Jr., M.D., M.P.H.

Permit Fee

\$50.00

Director, City-County Health Department

November 24, 1979

Daniel L. Bowlds

Date of Expiration

Environmentalist

NOTE: LEAVE ENTIRE SEWAGE-DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION.

24-HOUR ADVANCE NOTICE REQUIRED

651 Sq. Ft.

Septic tank	<u>1000</u>	gals.	Field	<u>217</u>	Feet of trench	<u>36</u>	inches wide
		OR.	Field	<u>326</u>	Feet of trench	<u>24</u>	inches wide
Seepage bed		ft. long		ft. wide.	Seepage pit	sq. ft.	diam. w/d

The Health Officer shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable times for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

EL PASO CITY-COUNTY HEALTH DEPARTMENT
501 NORTH FOOTE AVENUE
COLORADO SPRINGS, COLORADO
475-8240 EXT. 220

Application for permit to construct, Remodel, or Install a Sewage Disposal System

Name of Owner WALLY NESSCHAUF - E-2 ^{LEAVING HOME} Phone 473-5419

Address of Property 1973 SHRAIDER RD.

Legal Description of Property LOT 1, BLOCK 12 SE CORNER SHRAIDER & WALKER

Owner's Address (if different) _____ Phone _____

Systems Contractor Mountain Shadows Plumbing Address _____

Type of Construction Single Family Dwelling Source and Type of Water Supply Woodman Water

Size of Lot 1. +

The construction of the Sewage Disposal System will comply with all applicable Laws, Ordinances, Standards or Resolutions.

HEALTH DEPARTMENT USE ONLY

Permit Number _____

Receipt Number _____

Number of Bedrooms 3 Tank Capacity 1000 gallons Absorption area 930 Sq. Ft.

REMARKS GRADUAL SLOPE SOUTH TO NORTH, APPROVED PENDING AN ACCEPTABLE

"PERC" TEST - IDENTIFIED AREA 310 FT - 36 IN

465 FT - 24 IN

APPLICATION IS ☒ APPROVED ☐ DENIED

ENVIRONMENTALIST Rick A. Eays DATE 2/23 19 79

PLOT PLAN WILL INCLUDE THE FOLLOWING

Plot plan may be drawn on the back of this sheet or on a separate sheet.

1. Streams, Lakes, Ponds, Irrigation Ditches and other Water Courses
2. North Direction
3. Location of Property Line
4. Buildings
5. Wells
6. Location of Proposed Septic System
7. Location of percolation test
8. Geographical features
9. Other Information as required

NW POSITION
↓ 25 Property line

50 X 50