

CITY COUNTY HEALTH DEPARTMENT
COLORADO SPRINGS, COLORADO

7423400004

573
0000 P
Date of Insp. JAN. 14, 1969
Sanitarian Roy. Nordstrom

Approval: VA & FWA
Yes No

SEWAGE DISPOSAL INSPECTION FORM

701 Cresta Rd

Location (Street Number) off. of 21st St. (Cresta Rd. Skewed) occupant Mathew Res.
Legal Description part of Sec. 23, T. 14S, R. 67W, 6th P.M.
Contractor Robt. W. Servers Plumber Homer Moore & A.
Type Construction Frame & Brick Grade House Sewer
No. of Bedrooms 3

Primary Treatment:

(Septic Tank)
Type of material Approved type E.L. Paso Can. No. Compartments
Width Length Depth (off)
Depth (Total) Liquid capacity 2,000 Gallons


Secondary Treatment:

Leaching Pits (No) Soil Perc. Test
Lining Material Capacity in Gallons
Diam. Depth

Disposal Field Soil Perc. Test See Sheet
Total Length of tile lines 170' Number of Lines 2
Distance Between Lines 20' Length of each line 85' Absorb. Area
Type of tile ORANGEburg Trench Depth 2' Trench Width 24" Grade
Type Filter Material washed gravel Depth: Under Tile 6" Over Tile 2"

Cesspool:

Lining Material Soil Diam. Depth (off) Cap.

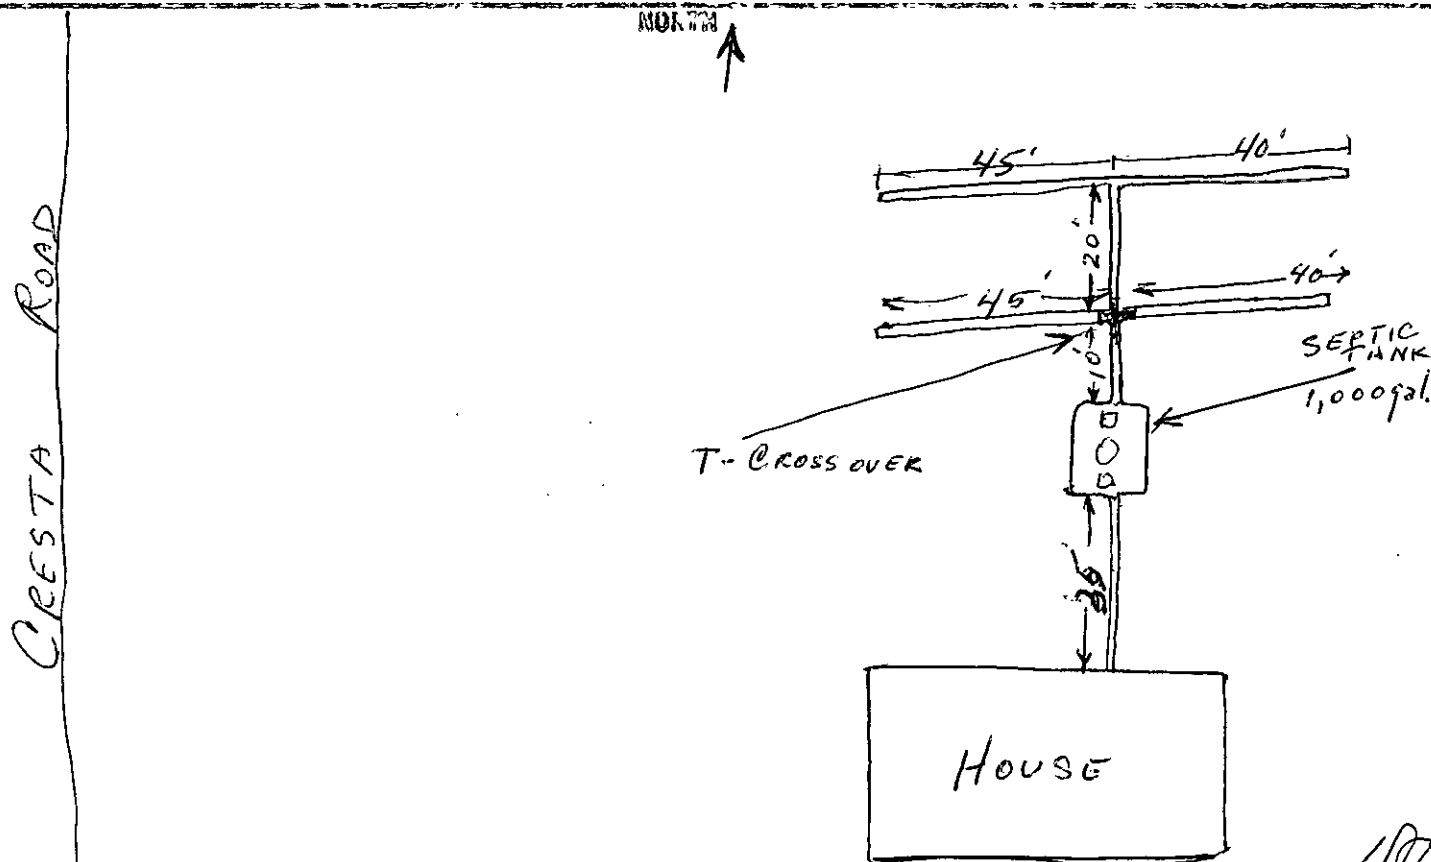

CITY-COUNTY HEALTH DEPARTMENT

Colorado Springs Colorado El Paso County

PERMIT

Individual Sewage Disposal System (Construction, Alteration or Repair)

Issued To Robert W Severe

Date Oct. 4, 1968

573

Address of Property A part of SE1/4, of Sec 29, T14S, R 67W, 6th P.M. (Gresta Road & Skyway)

(Permit valid at this address only)

Builder - Contractor - Owner—Address Same

Phone

Sewage-Disposal System work to be performed by Homer Moore, Plumbing & Heating

This Permit is issued in accordance with Regulation XII and Article 2 of Chapter 66, Colorado Revised Statutes 1963, as amended by the addition of a new Section 66-2-16. (H.B. 1205, 7-1-65). **PERMIT EXPIRES** upon completion—installation of sewage-disposal system or at the end of six (6) months from date of issue—whichever occurs first—(unless work is in progress).

April 4, 1969

(Date of Expiration)

R. K. Miller, M. D.

Director, City-County Health Dept.

Permit Fee \$ 5.00

Mileage (8c/mile to and from site) 15 1.20

Total Fee \$ 6.20

NOTE: Leave entire sewage-disposal system uncovered for final inspection.

24-hour advance notice required.

Septic tank 1,000 gals. Field 170 feet of trench 24 inches wide.

180 " " " 30 " "

Seepage bed _____ ft. long _____ ft. wide. Seepage pit _____ gallons.

The Health Officer shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative.